


**\* LUS SHALL INSPECT HOLE BEFORE INSTALLATION OF METER POLE**

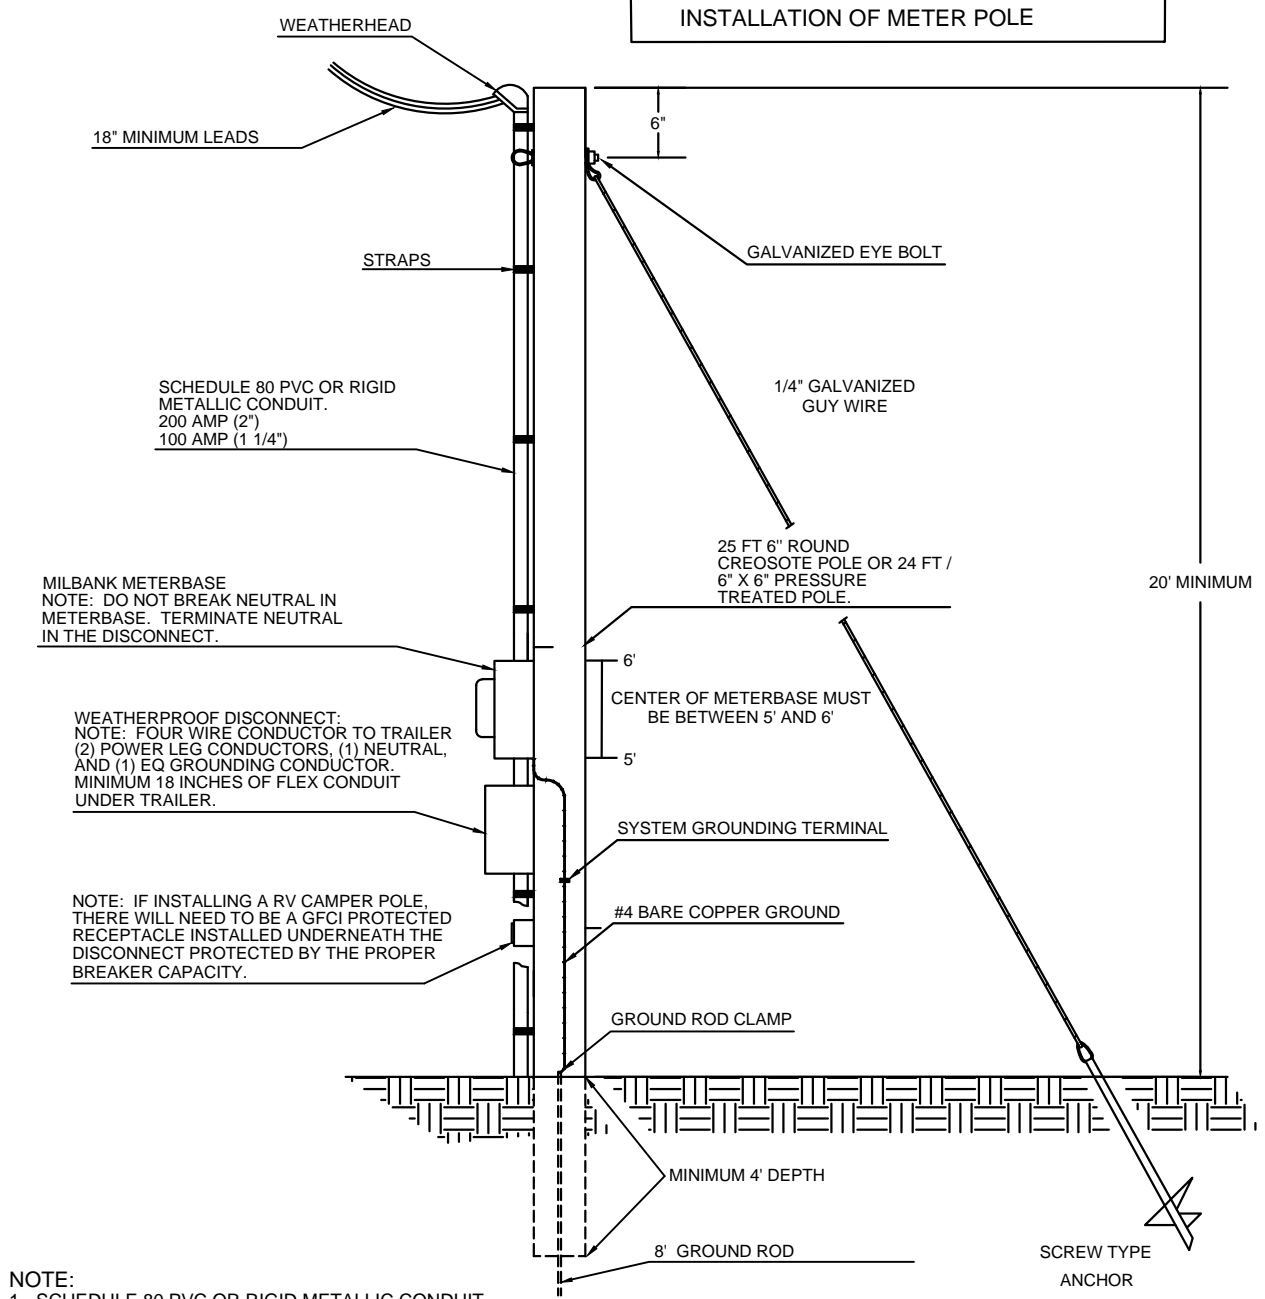

**NOTE:**  
 1 - SCHEDULE 80 PVC OR RIGID METALLIC CONDUIT FOR RISER. FLEXIBLE CONDUIT MAY BE USED FROM DISCONNECT. DO NOT RUN FLEXIBLE CONDUIT UNDERGROUND.

2 - 200 AMP COMMERCIAL METER POLE (BARN, WATER PUMP, ETC...) WILL NEED TO BE UPGRADED TO 3/0 COPPER CONDUCTOR WITH 1/0 NEUTRAL

WIRE SIZES				
AMPS	TYPE	CONDUCTOR	NEUTRAL	EQ. GROUND
100	COPPER	#3	#6	#6
100	ALUMINUM	#1	#4	#4
200	COPPER	2/0	#1	#6
200	ALUMINUM	4/0	2/0	#4

**MINIMUM MOBILE HOME AND RV POLE REQUIREMENTS**

SCALE: NOT TO SCALE	DATE: 10-11-2018	
DRAWN BY: AUSTIN CAPERTON		SHEET NO. 1

**LAWRENCEBURG UTILITY SYSTEMS**  
 1607 N LOCUST AVENUE  
 LAWRENCEBURG, TN 38464  
 (931) 762-7161